



Infrastructure Technologies

Gate 5, 2 Normanby Road Clayton VIC 3168, Australia

Telephone: 61 3 9545 2777 Web: <http://www.csiro.au>

Registered Testing Authority - CSIRO

1 October 2019

Our Ref. EN13 / 2582 03/0212

TEST REPORT No. 8283

Requested by: Decoline Pty Ltd
3/3363-3365 Pacific Highway
Slacks Creek,
QLD 4127

on (date): 21 August 2019

Manufacturer: Decoline Pty Ltd

Product Desc.: Natural SPC Hybrid, SPC Hybrid 5.5mm + 1.5mm IXPE Backing, PU Coating.

Sampling details:

Where: At customer premises

Date: 26 August 2019

By whom: customer (delivered by courier)

How (methods): N/A

The results reported relate only to the sample(s) tested and the information received. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. CSIRO cannot accept responsibility for deviations in the manufactured quality and performance of the product. While CSIRO takes care in preparing the reports it provides to clients, it does not warrant that the information in this particular report will be free of errors or omissions or that it will be suitable for the client's purposes. CSIRO will not be responsible for the results of any actions taken by the client or any other person on the basis of the information contained in the report or any opinions expressed in it. The reproduction of this test report is only authorised in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 4 pages

SUMMARY OF SLIP RESISTANCE TESTS PERFORMED:

		Result	Class
AS 4586:2013	Slip resistance classification of new pedestrian surface materials Appendix A: WET PENDULUM TEST METHOD (Slider 96): Mean SRV:	46	P4

In order to interpret the classifications, please refer to Standards Australia Handbook 198, An Introductory Guide to the Slip Resistance of Pedestrian Surface Materials, which recommends minimum classifications for a wide variety of locations.

It is important to realise that test results obtained on unused factory-fresh samples may not be directly applicable in service, where proprietary surface coatings, contamination, wear and subsequent cleaning all influence the behaviour of the pedestrian surface.




REPORT NO: 8283 Page 2 of 4
ISSUE DATE: 1 October 2019
MANUFACTURER: Decoline Pty Ltd
PRODUCT DESC: Natural SPC Hybrid, SPC Hybrid 5.5mm + 1.5mm IXPE Backing, PU Coating.

PHOTOS:



Top view

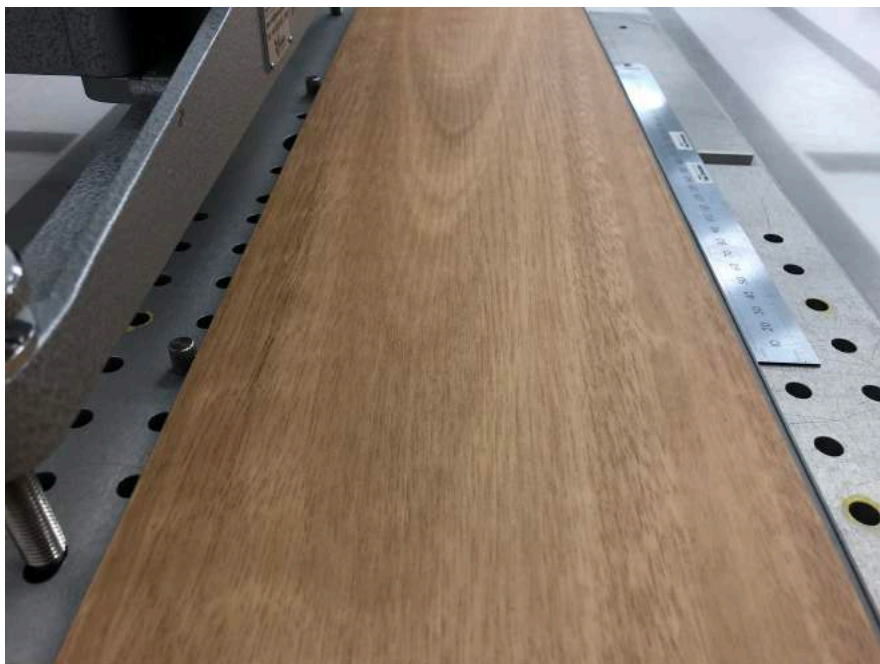

Close up



REPORT NO: 8283 Page 3 of 4
 ISSUE DATE: 1 October 2019
 MANUFACTURER: Decoline Pty Ltd
 PRODUCT DESC: Natural SPC Hybrid, SPC Hybrid 5.5mm + 1.5mm IXPE Backing, PU Coating.

SLIP RESISTANCE CLASSIFICATION OF NEW PEDESTRIAN SURFACE MATERIALS

WET PENDULUM TEST METHOD

TEST CARRIED OUT IN ACCORDANCE WITH
AS 4586:2013 (Appendix A)

Test Date: 1 October 2019

RESULTS: Location: Slip Resistance Laboratory Slider used: 96
Conditioned with grade P400 paper, dry
and Imperial Lapping Film Grade 3MIC, wet

Sample: Unfixed
 Cleaning: Deionized water
 Temperature: 21.9°C

Pendulum Friction Tester: ERM 030.040 (S/N: 1726, calibrated 20/09/19), S 96 serial #: 87 (expired on 20/2/2020)
Test conducted by: Khanh Ho

	Specimen				
	1	2	3	4	5
Last 3 swings (BPN)	50	45	47	46	44
	49	45	46	45	43
	49	45	46	45	43
Averages	49	45	46	45	43

Mean SRV : 46

CLASS :

P4



Infrastructure Technologies

Gate 5, 2 Normanby Road Clayton VIC 3168, Australia

Telephone: 61 3 9545 2777 Web: <http://www.csiro.au>

REPORT NO: 8283 Page 4 of 4
ISSUE DATE: 1 October 2019
MANUFACTURER: Decoline Pty Ltd
PRODUCT DESC: Natural SPC Hybrid, SPC Hybrid 5.5mm + 1.5mm IXPE Backing, PU Coating.

Date and Place 1 October 2019, Clayton, Vic

Name, Title and Digital Signature:

A circular digital signature stamp. It features a greyish-blue background with the CSIRO logo (stylized vertical bars) and the word "CSIRO" in a light font. Overlaid on this is a black, cursive handwritten signature.

KHANH HO
Technical Officer
Tel: 61 3 95452777
Email: Khanh.Ho@csiro.au